


Wiring Legend

—Field Wiring—

-Factory Wiring— — — —

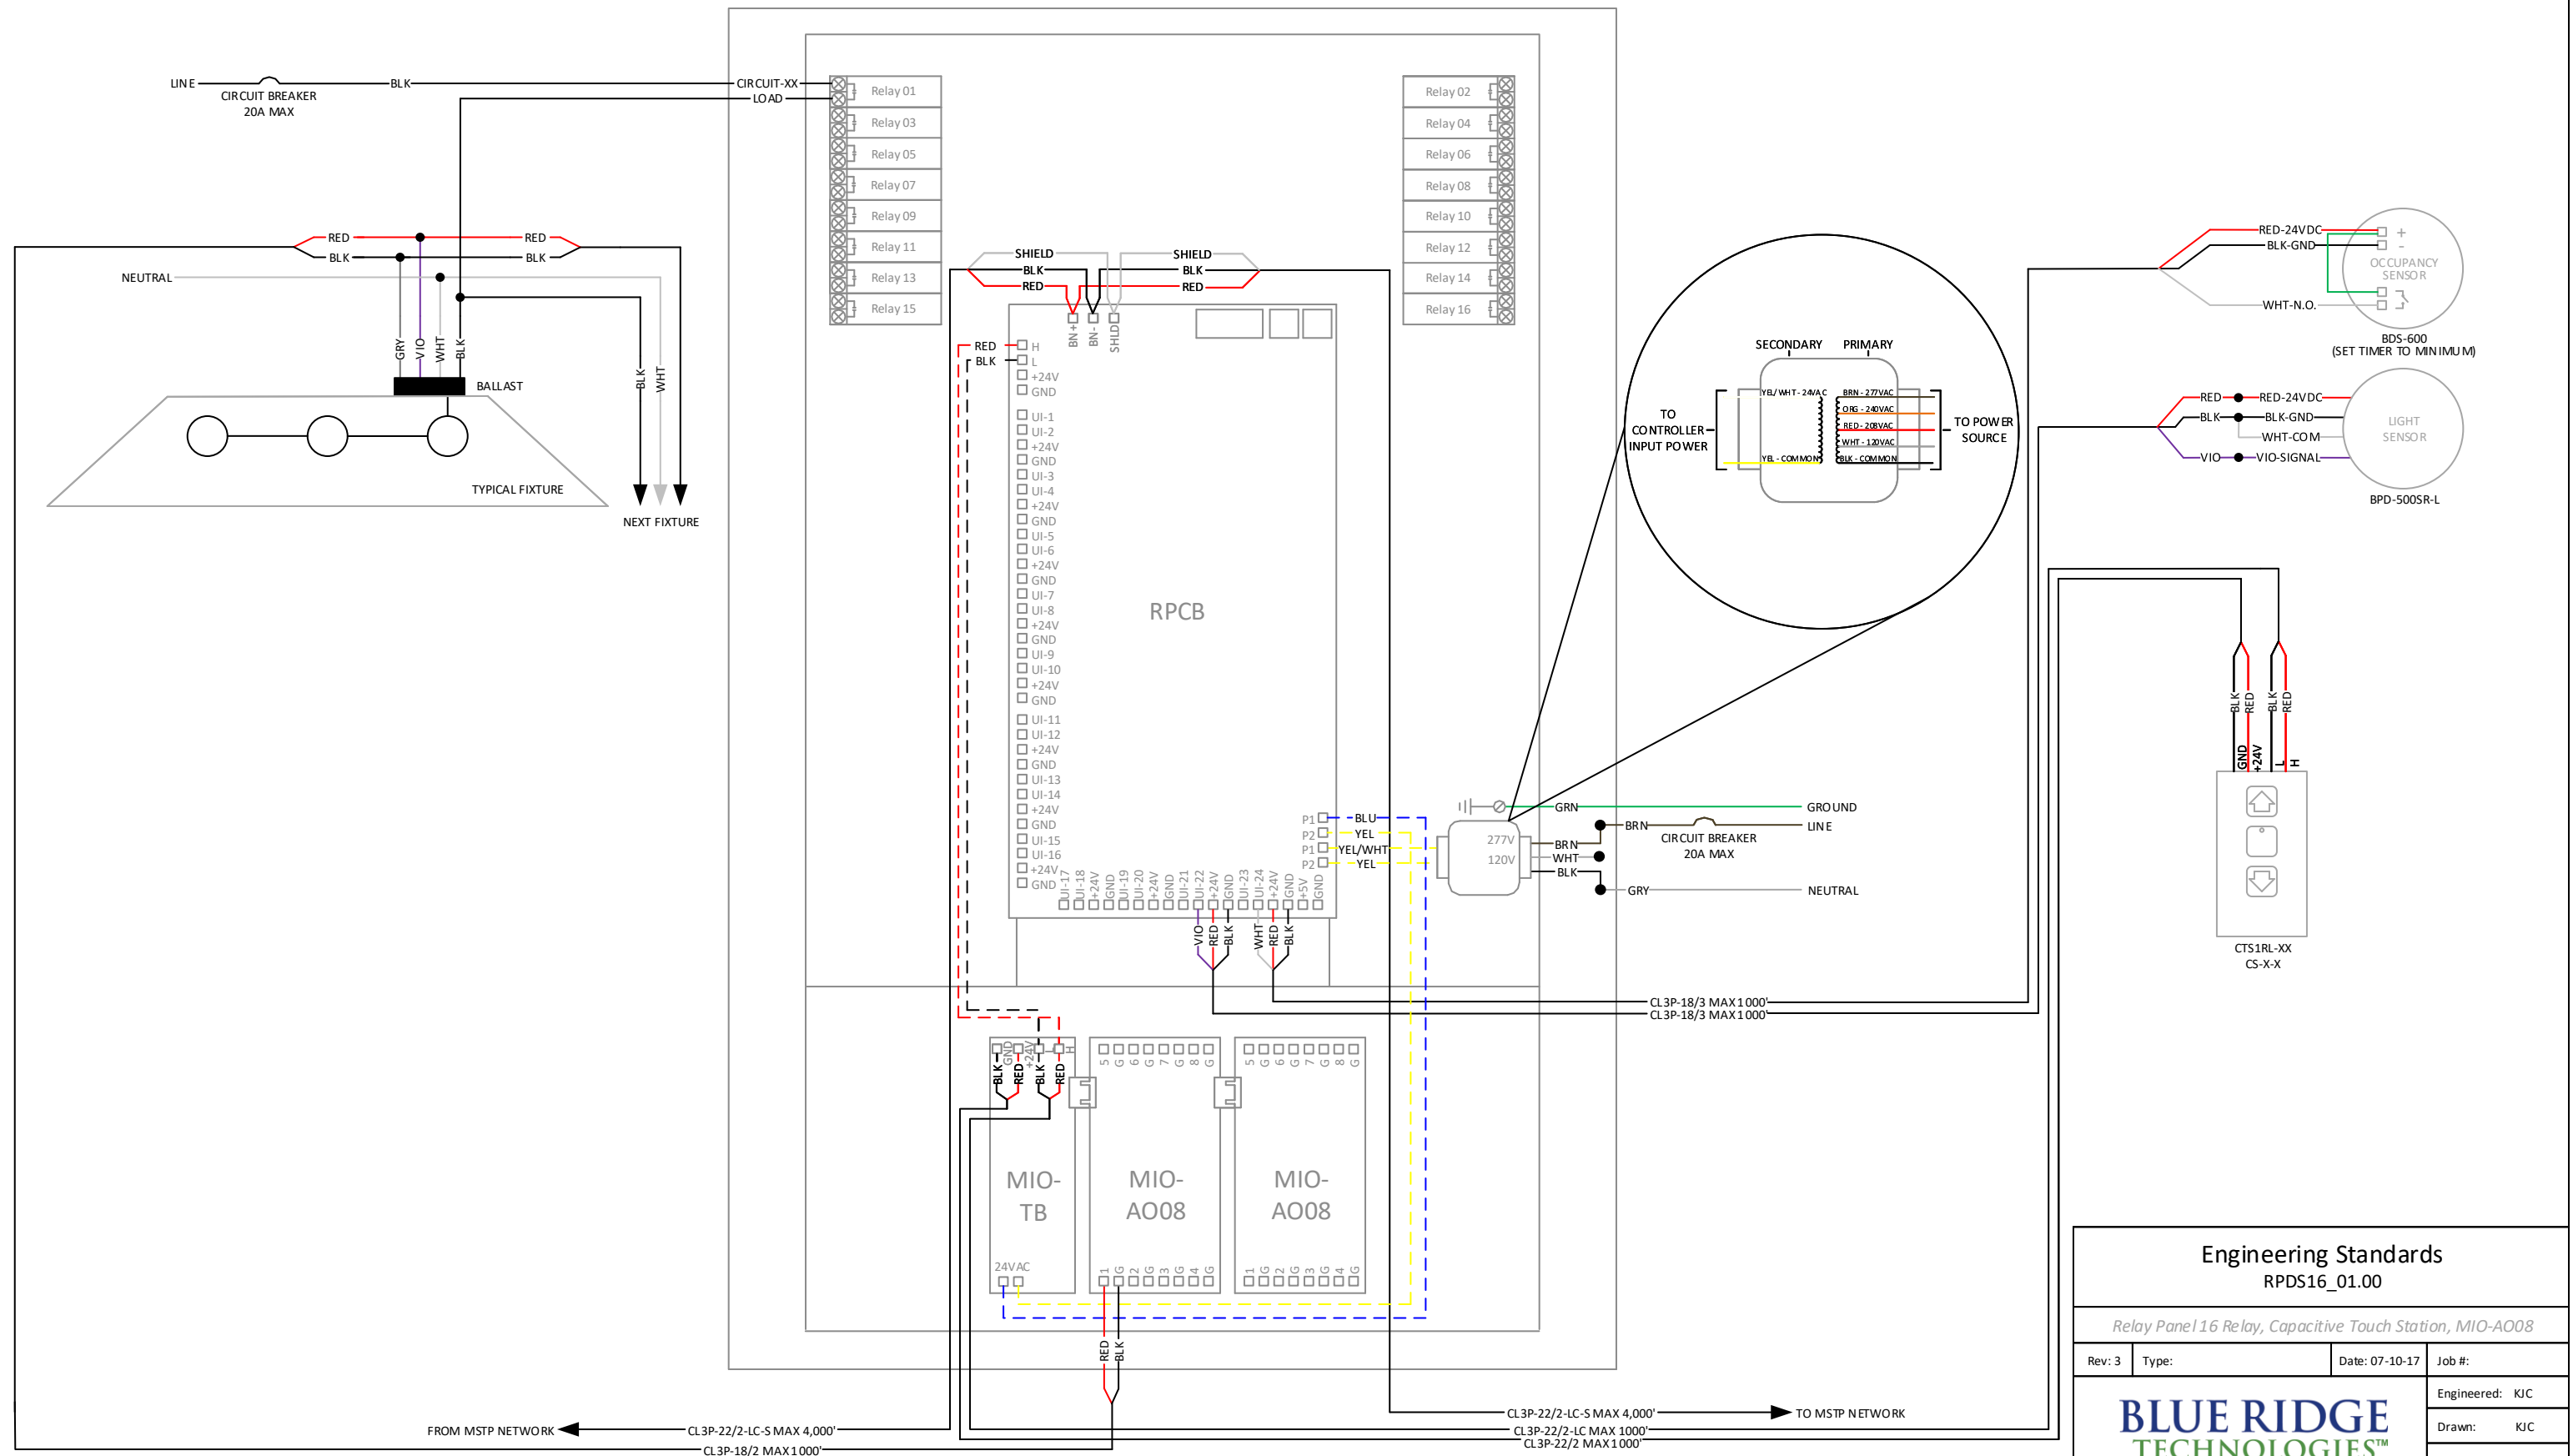

Engineering Standards
RPDS16_01.00

Relay Panel 16 Relay, Capacitive Touch Station, MIO-A008

Rev: 3	Type:	Date: 07-10-17	Job #:
			Engineered: KJC
			Drawn: KJC
			Checked: CLO
			Page: 1 of 1