


Wiring Legend

———— Field Wiring ————
----- Factory Wiring -----

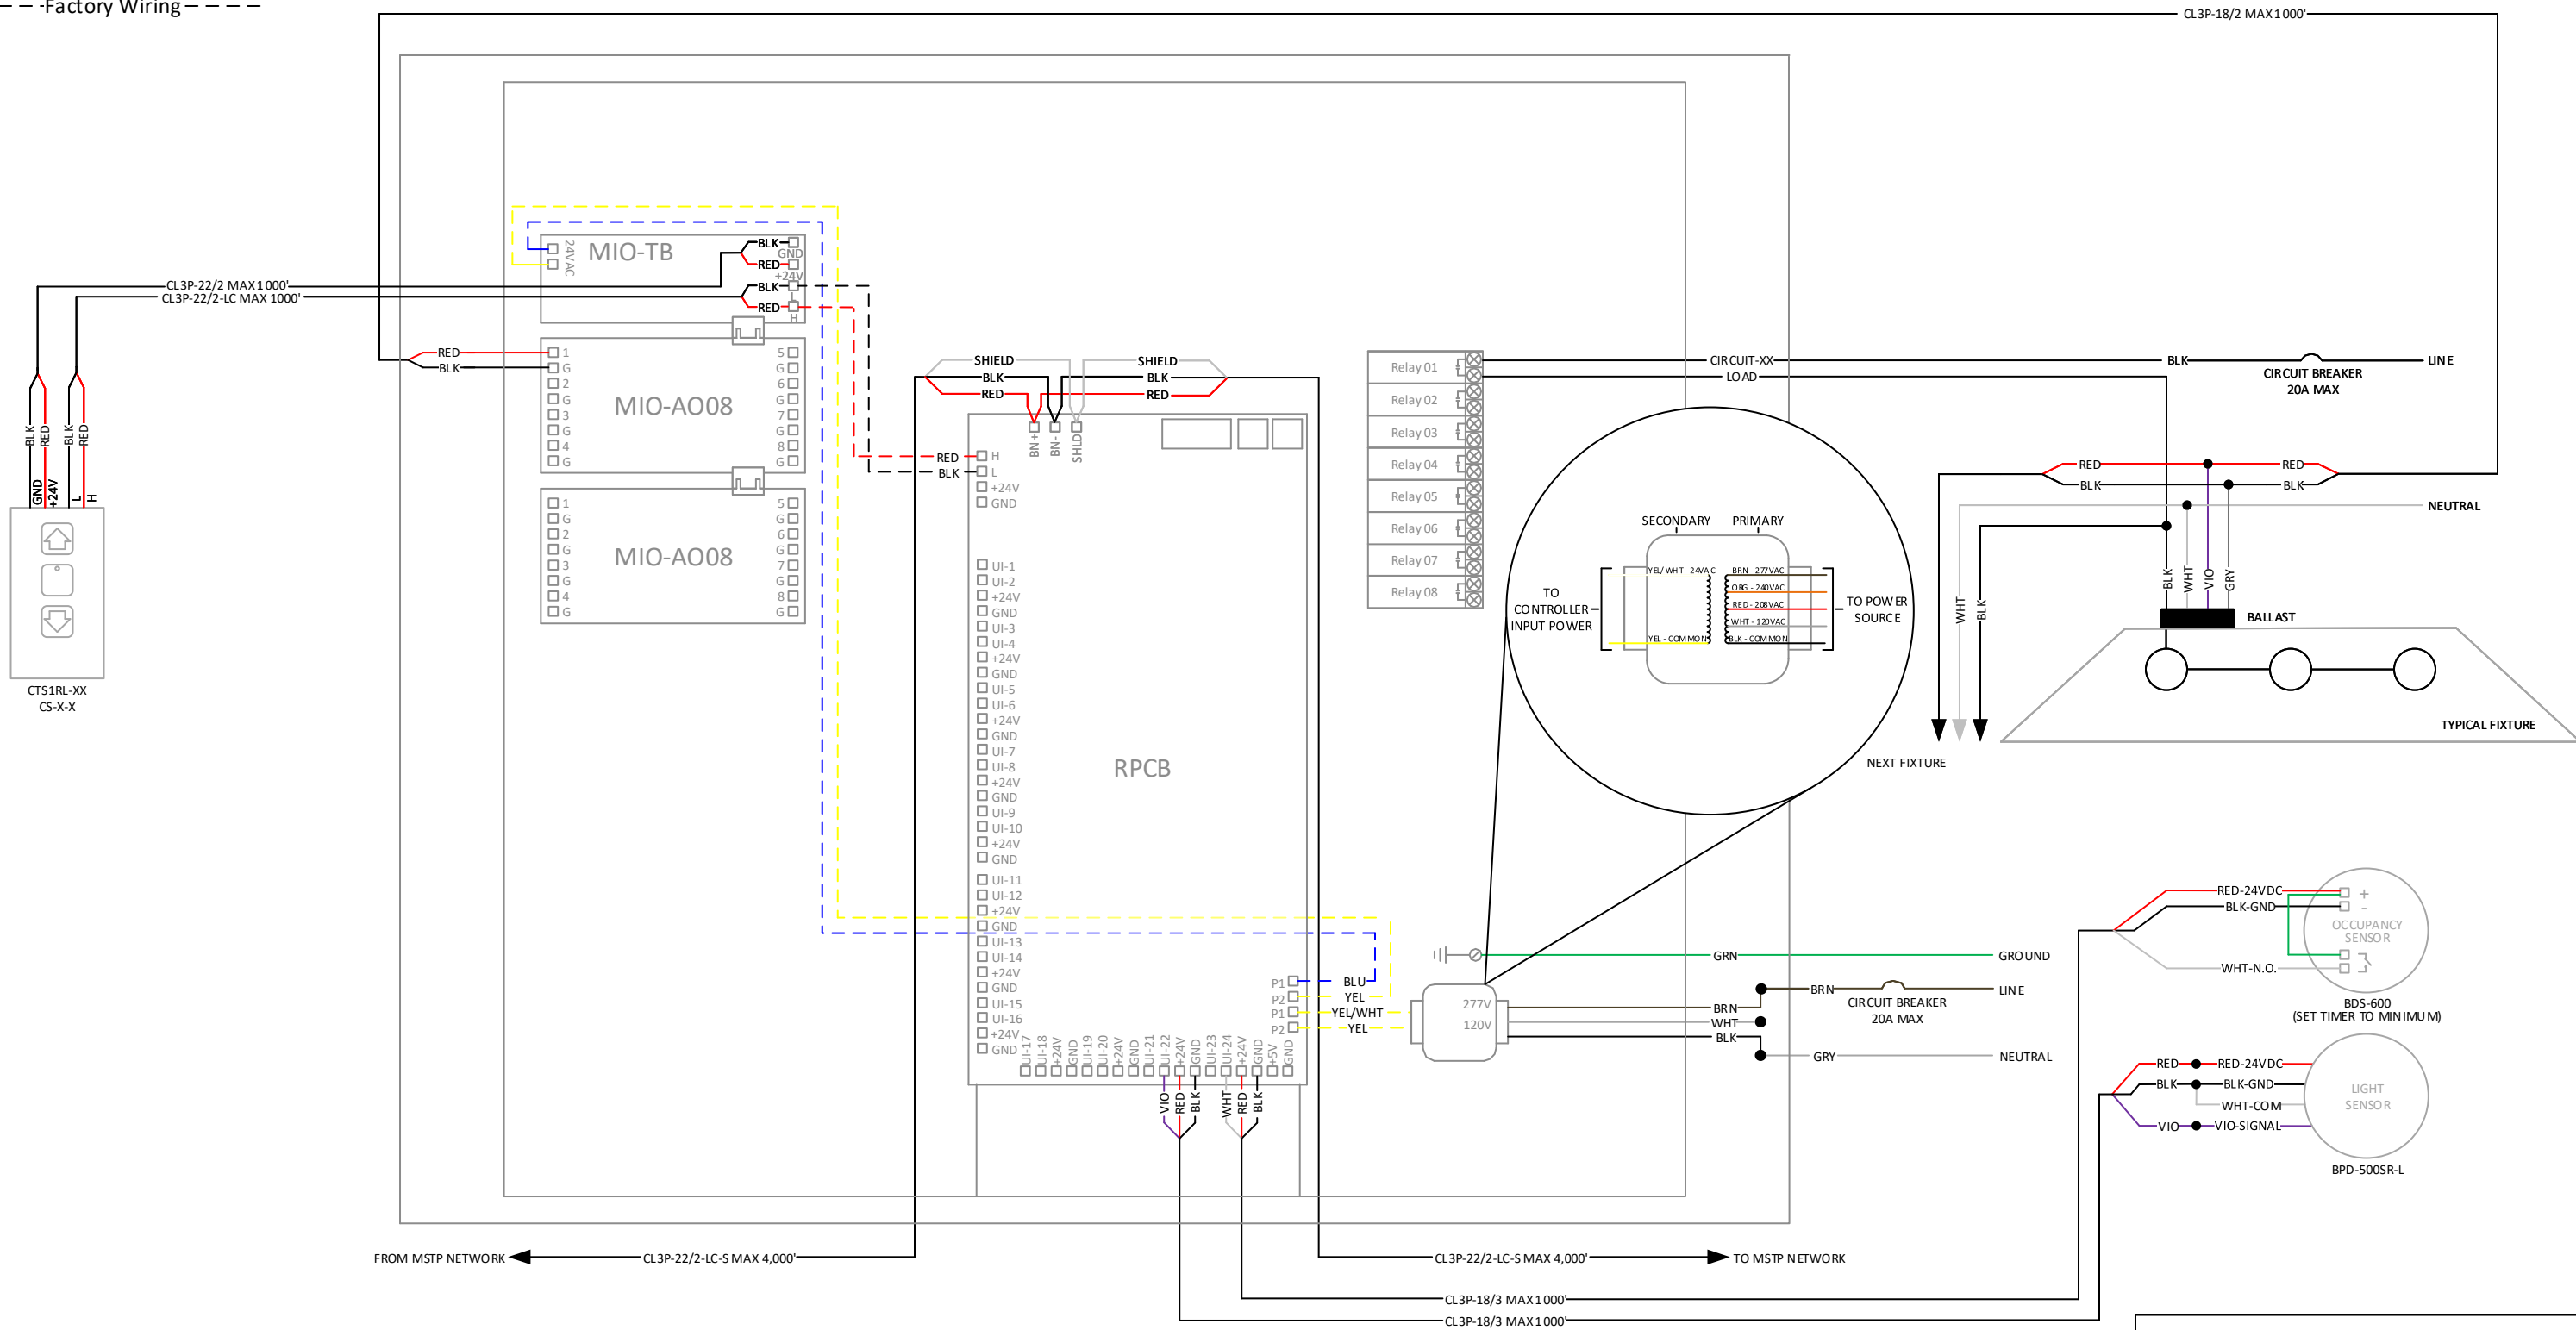

Engineering Standards			
RPDS08_01.00			
Relay Panel 8 Relay, Capacitive Touch Station, MIO-AO08			
Rev: 3	Type:	Date: 07-10-17	Job #:
<div>BLUE RIDGE TECHNOLOGIES™ UNIFIED LIGHTING CONTROL</div>			Engineered: KJC
			Drawn: KJC
			Checked: CLO
			Page: 1 of 1