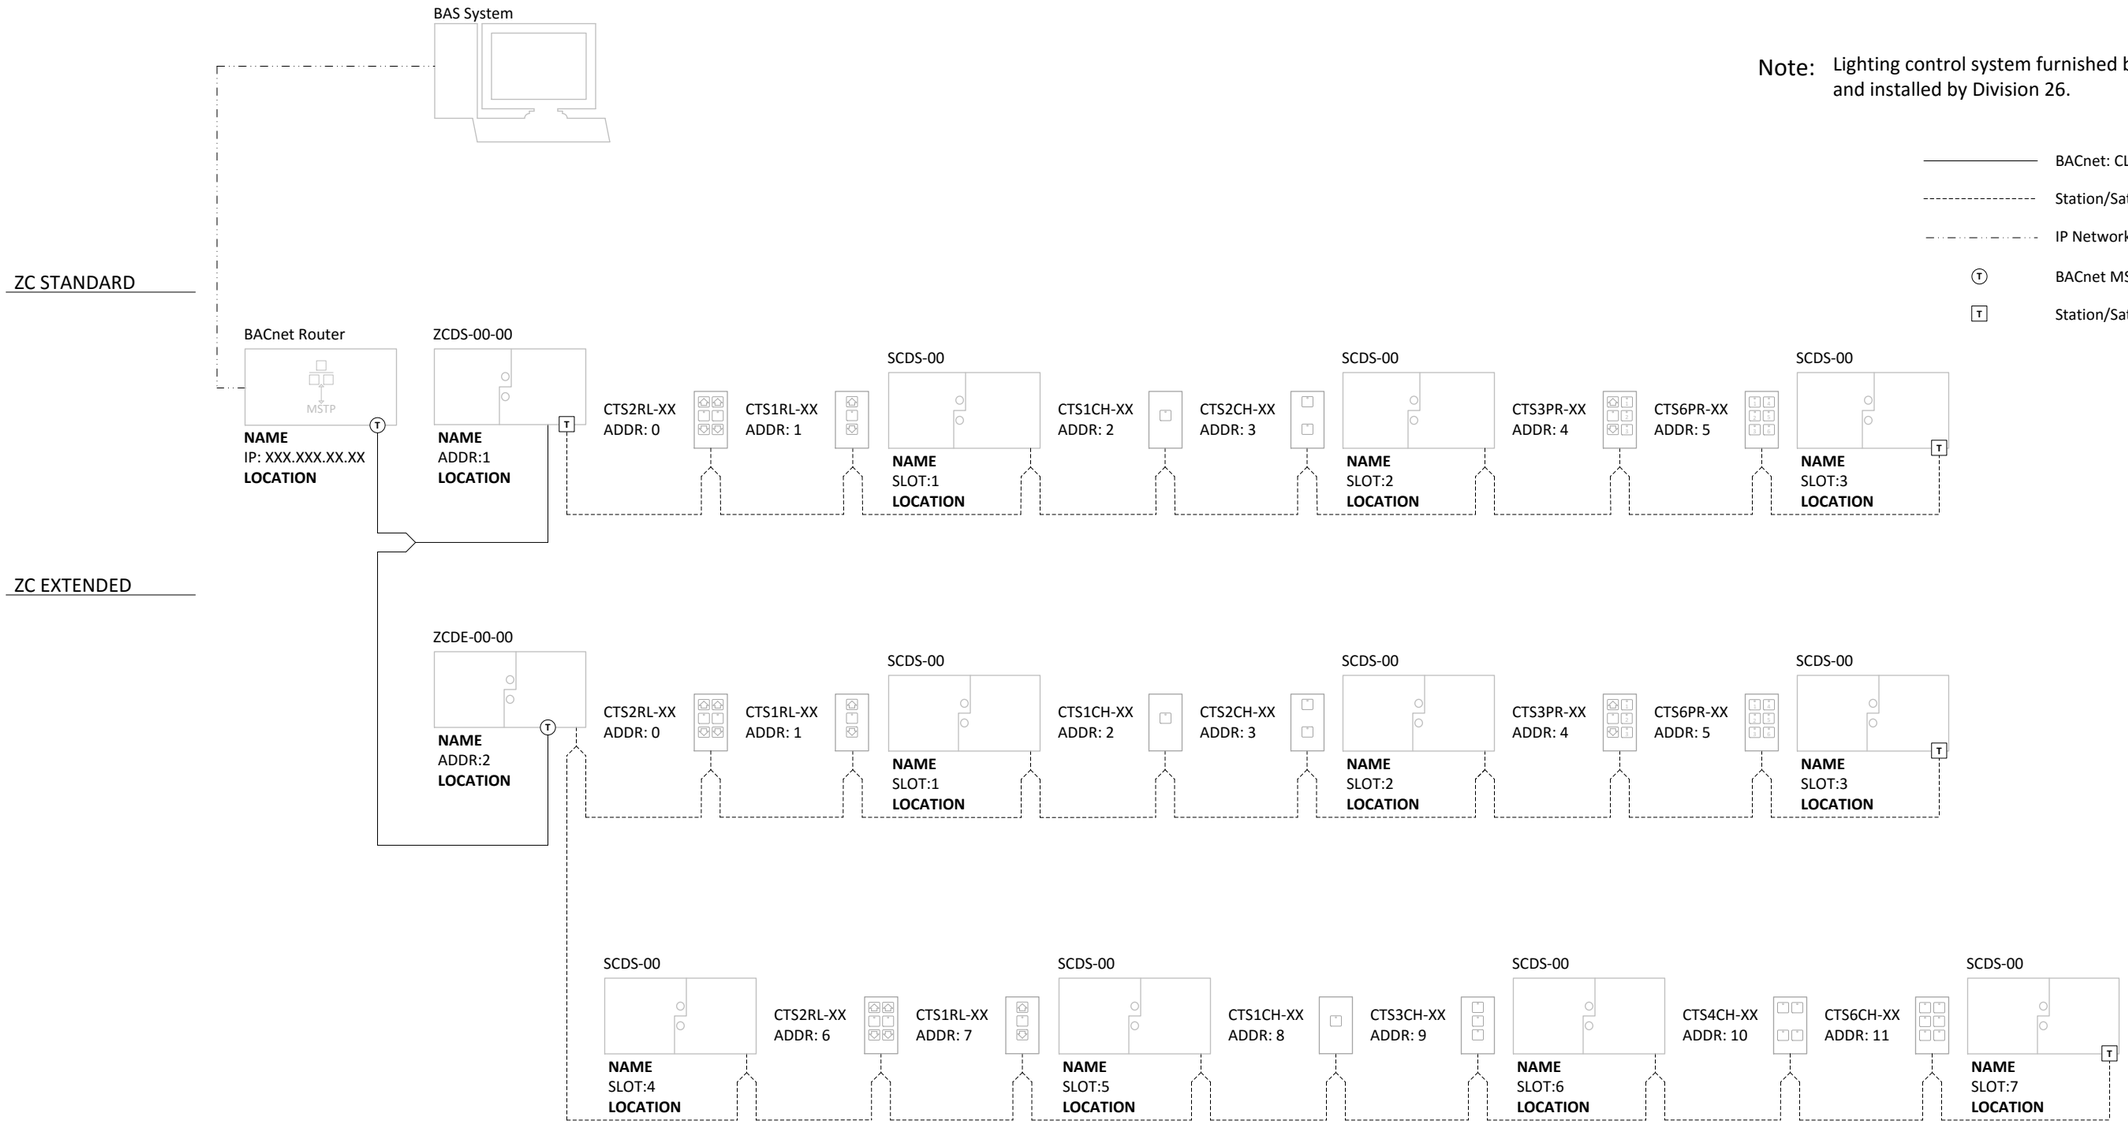

Note: Lighting control system furnished by Division 25 (Controls Contractor) and installed by Division 26.

BACnet: CL3P 22/2 Shielded, Low Cap, Max 4,000'

Station/Satellite Network: CL3P 18/4, Max 1300'

IP Network: CAT-5e, Max 328'

BACnet MS/TP Network Terminator

Station/Satellite Network Terminator

Engineering Standards SYS_02.00_SD			
Zone Control System Riser			
Rev: 4	Type: Source Document	Date: 01-20-15	Job #:
BLUE RIDGE TECHNOLOGIES™ UNIFIED LIGHTING CONTROL			Engineered: WCD
			Drawn: NB
			Checked:
			1 of 1